



Appendix G
Figures

Boring/Jacking/Push-Augering Layout

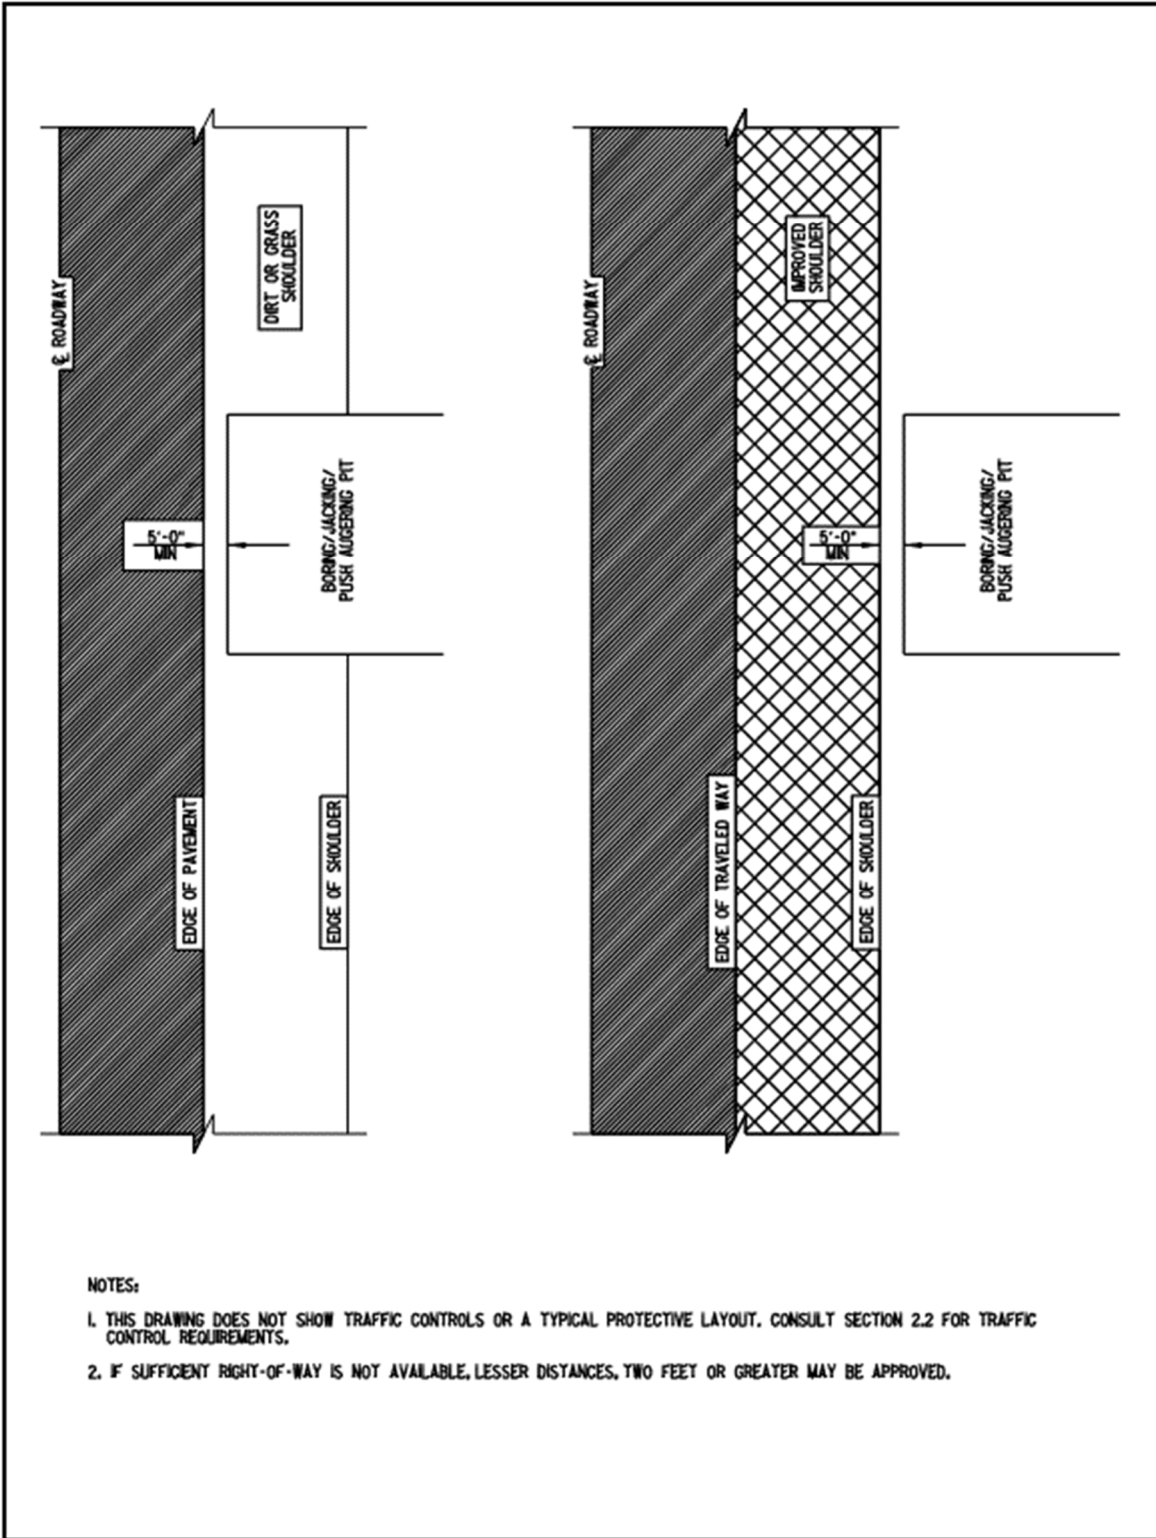

Temporary Patch


MINIMUM DESIGN REQUIREMENTS
(DISTRICT ENGINEER MAY CHANGE
REQUIREMENTS IN SPECIAL CASES)

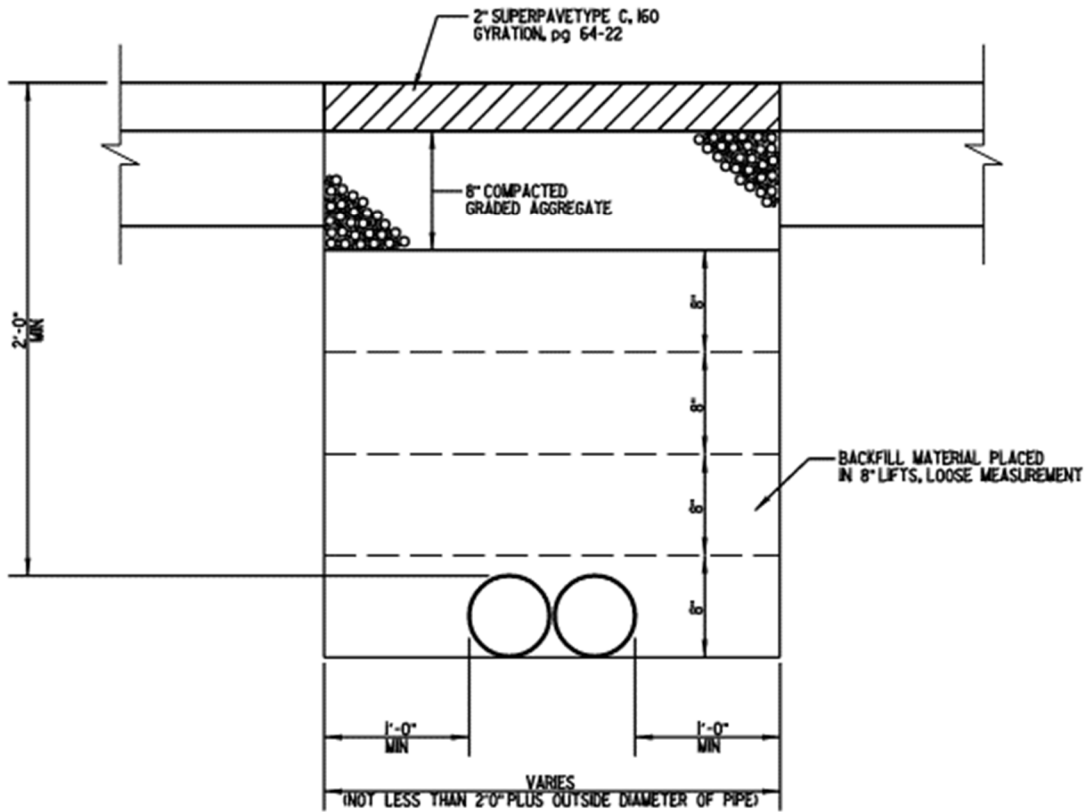

NOTES:

1. TEMPORARY PATCHES FROM WINTER MONTHS SHALL BE PERMANENTLY RESTORED BY MAY 15.
2. IN LIEU OF GABC, ROTOMILLINGS OR CRUSHED CONCRETE CAN BE USED IF THE FOLLOWING REQUIREMENTS ARE MET:
 - ROTOMILLINGS SPECIAL PROVISION 302514 AS SHOWN IN APPENDIX L.
 - CRUSHED CONCRETE SUPPLEMENTAL SPECIFICATIONS 302 AND 82L.
3. THE BACKFILL MATERIAL SHALL MEET THE REQUIREMENTS FOR BORROW, TYPE C AS PER SECTION 209 OF THE STANDARD SPECIFICATIONS.
4. COMPACTION SHALL MEET THE REQUIREMENTS AS PER SECTION 209 OF THE STANDARD SPECIFICATIONS.
5. FLOWABLE FILL IS ALLOWABLE AS A BACKFILL MATERIAL. FLOWABLE FILL SHALL MEET THE REQUIREMENTS OF SPECIAL PROVISION 208500 AS SHOWN IN APPENDIX F.
6. ALL MATERIALS AND METHODS OF CONSTRUCTION SHALL MEET THE REQUIREMENTS SET FORTH IN THE CURRENT DELAWARE DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.

Minimum Permanent Cross-Road or Longitudinal Patch For Surface Treatments or Hot Mix Pavements

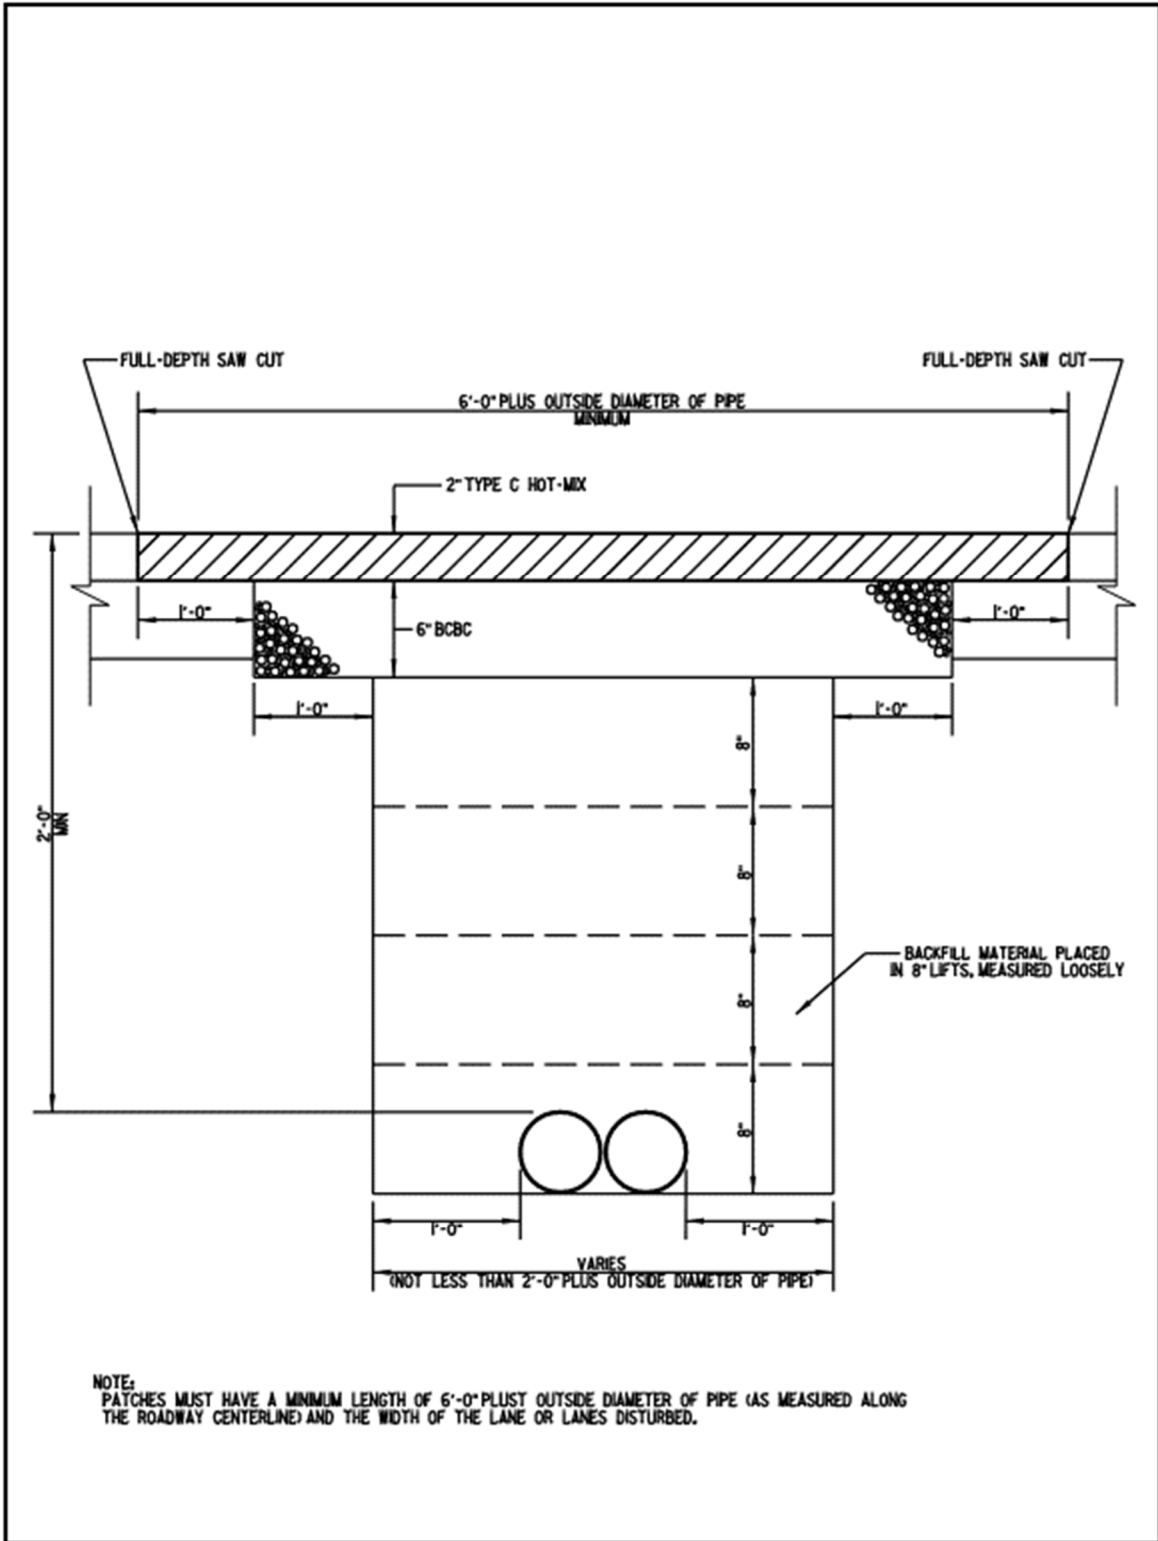

Roadway Patching Details at Manholes

