



SCALE :

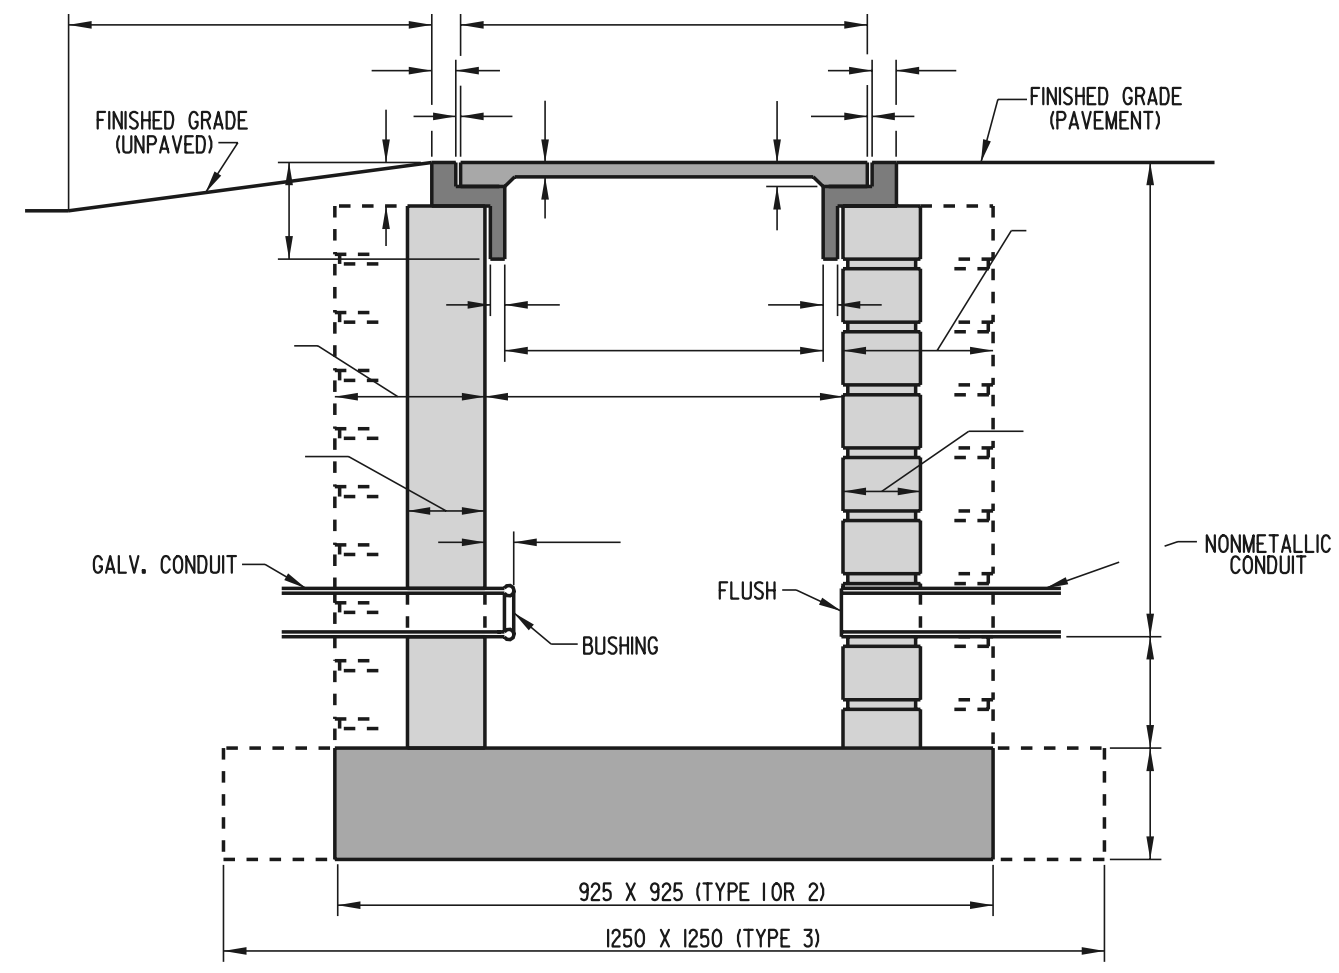

SECTION A-A

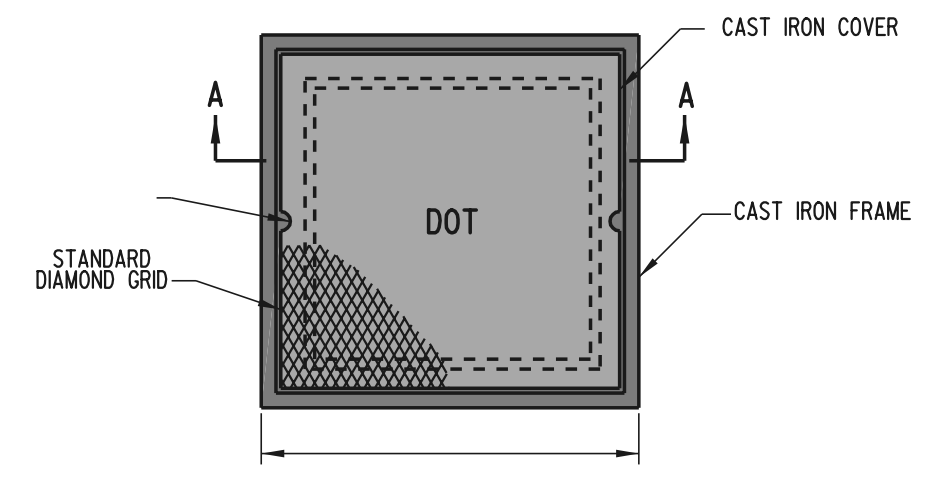

PLAN VIEW

- NOTES:**
- 1). TYPE 1 CONDUIT JUNCTION WELL SHALL BE PRECAST CONCRETE. AT LEAST ONE HOLE IN SHALL BE PLUGGED.
 - 2). TYPE 2 AND TYPE 3 CONDUIT JUNCTION WELLS SHALL BE BRICK AND WILL CONFORM TO STANDARD SPECIFICATIONS FOR BRICK MASONRY. JOINTS SHALL BE CONCAVE TYPE.
 - 3). ALL CONDUIT JUNCTION WELLS CONSTRUCTED WITHIN PAVEMENT, SIDEWALKS, ETC. WILL BE CONSTRUCTED FLUSH WITH THE SURFACE OF THE SAME. INSTALLATION IN UNPAVED AREAS WILL BE CONSTRUCTED

PLAN SYMBOL



**DELAWARE
DEPARTMENT OF TRANSPORTATION**

CONDUIT JUNCTION WELL, TYPES 1, 2, AND 3

STANDARD NO. **T-1 (97)** SHT. **1** OF **1**

APPROVED _____ DATE _____
CHIEF ENGINEER

RECOMMENDED _____ DATE _____
DESIGN ENGINEER