



SECTION G-G

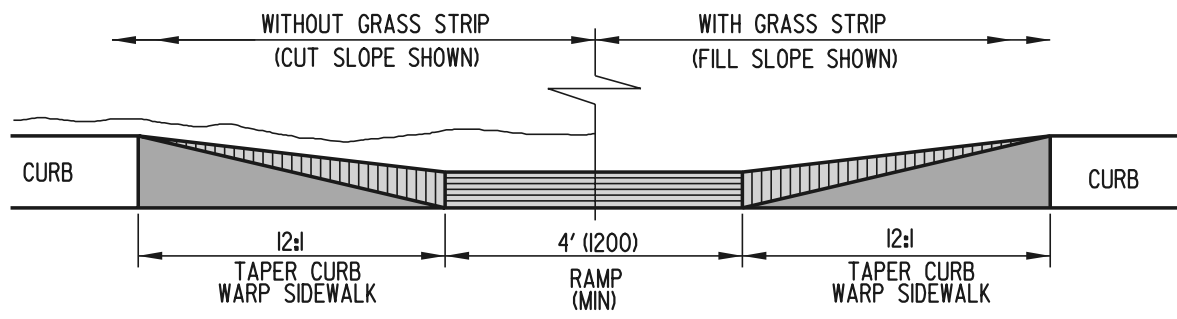

SECTION H-H

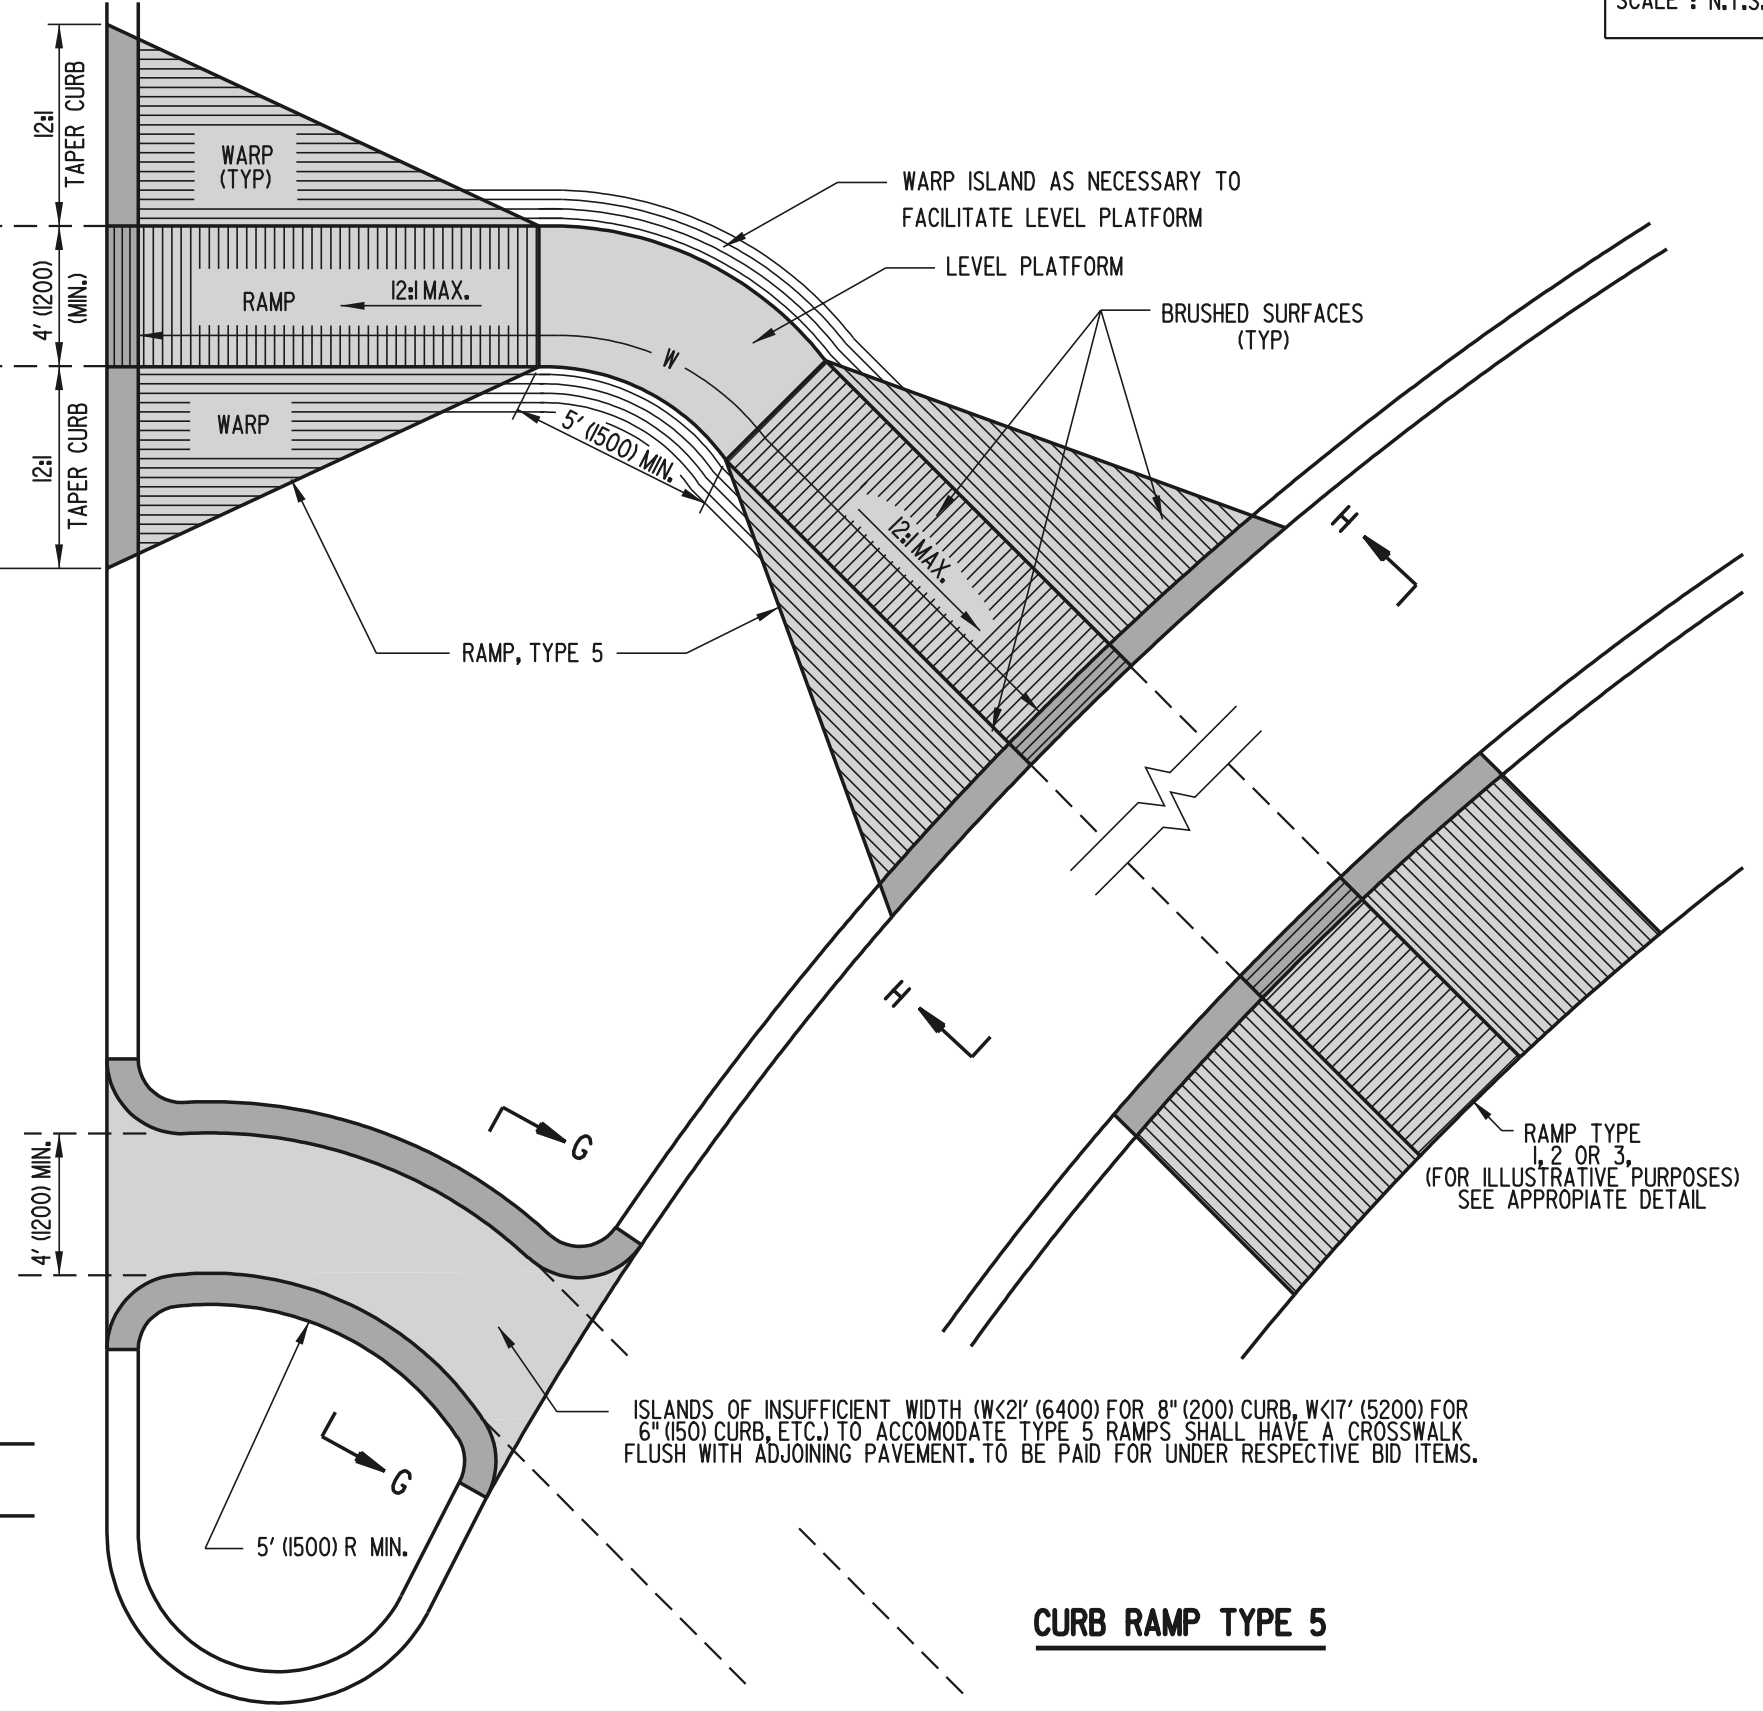

CURB RAMP TYPE 5

ISLANDS OF INSUFFICIENT WIDTH (W<21' (6400) FOR 8" (200) CURB, W<17' (5200) FOR 6" (150) CURB, ETC.) TO ACCOMMODATE TYPE 5 RAMPS SHALL HAVE A CROSSWALK FLUSH WITH ADJOINING PAVEMENT. TO BE PAID FOR UNDER RESPECTIVE BID ITEMS.