


PLAN


- NOTES:**
- 1). ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE PIPED UNDER THE ENTRANCE. IF NECESSARY, A MOUNTABLE BERM WITH 5:1 SLOPES SHALL BE ALLOWED TO FACILITATE PLACEMENT OF PIPES IN SHALLOW CONDITIONS.
 - 2). THE LOCATION AND NUMBER OF STABILIZED CONSTRUCTION ENTRANCES SHALL BE AS INDICATED ON THE PLANS. ANY CHANGE IN LOCATION, ADDITION, OR DELETION OF AN ENTRANCE SHALL BE APPROVED IN ADVANCE BY THE ENGINEER.
 - 3). DRAINAGE PIPE, IF UTILIZED, SHALL BE PAID FOR SEPARATELY UNDER THE APPROPRIATE BID ITEM.
 - 4). THE TOP 2" (50) OF STONE SHALL BE REMOVED AND REPLACED WITH 2" (50) OF CLEAN STONE WHEN VOIDS ARE FILLED OR AS DIRECTED BY THE ENGINEER.

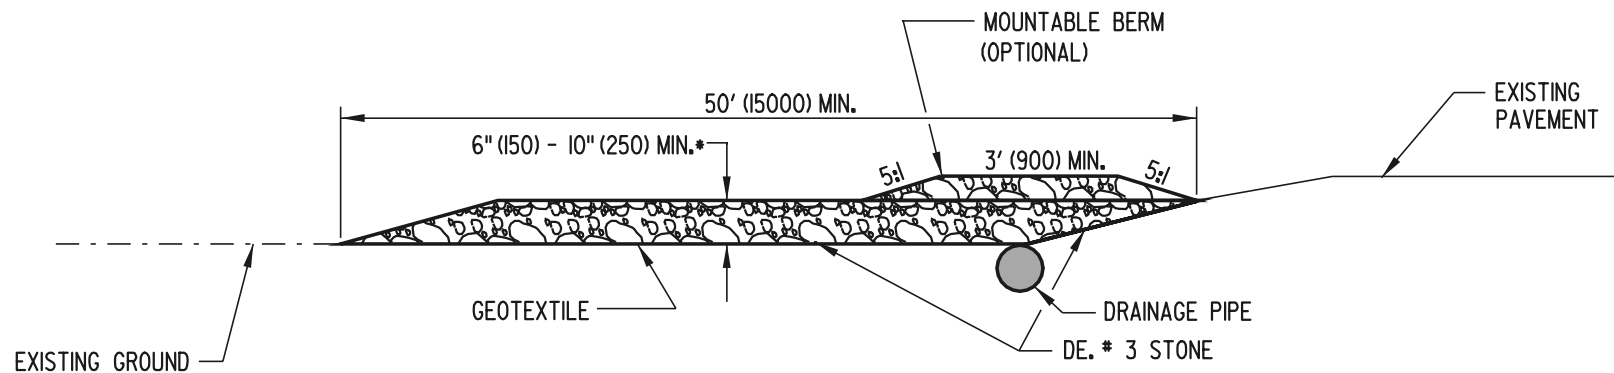

SECTION A-A

* 6" (150) MIN. (< 3 AXLE)
10" (250) MIN. (> 3 AXLE)

PLAN SYMBOL



**DELAWARE
DEPARTMENT OF TRANSPORTATION**

STABILIZED CONSTRUCTION ENTRANCE

STANDARD NO. **E-21 (2001)** SHT. **1** OF **1**

APPROVED *Ryan M. Harshbarger* **6/18/01**
CHIEF ENGINEER DATE
 RECOMMENDED *Mehal Rajda* **6/18/01**
DESIGN ENGINEER DATE