




**P.C.C. CURB**  
TYPE I

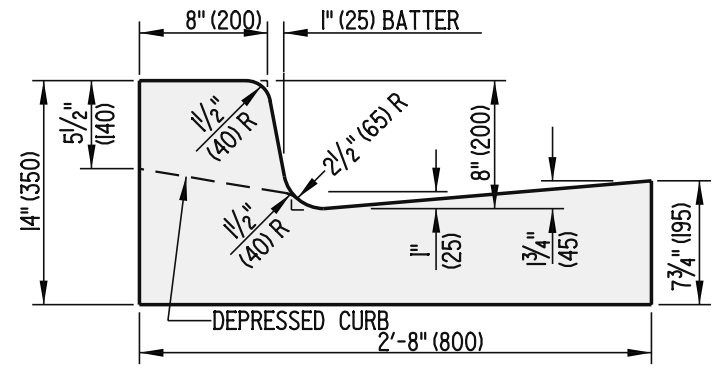


**INTEGRAL P.C.C. CURB AND GUTTER**  
TYPE 1

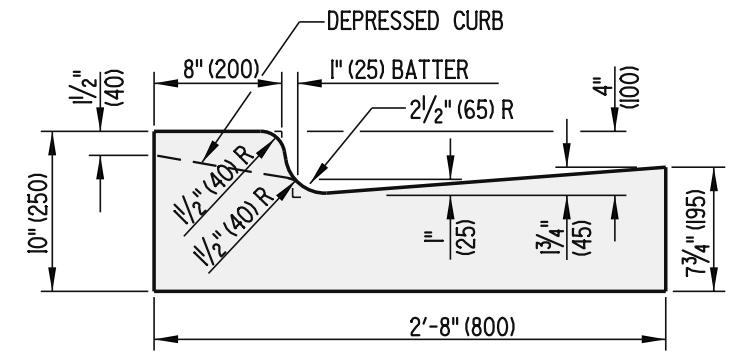


**INTEGRAL P.C.C. CURB AND GUTTER**  
TYPE 4

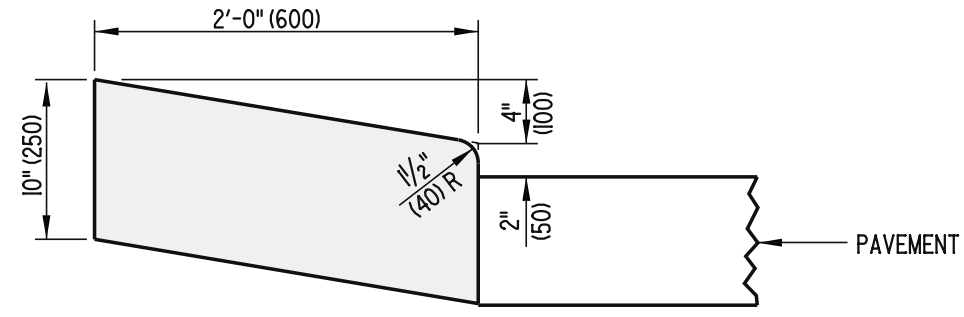


**P.C.C. CURB**  
TYPE 2

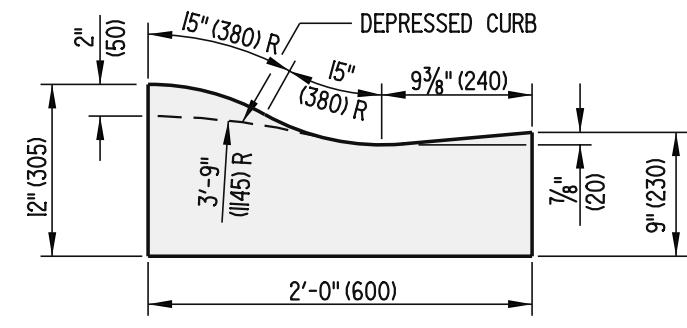


**INTEGRAL P.C.C. CURB AND GUTTER**  
TYPE 2

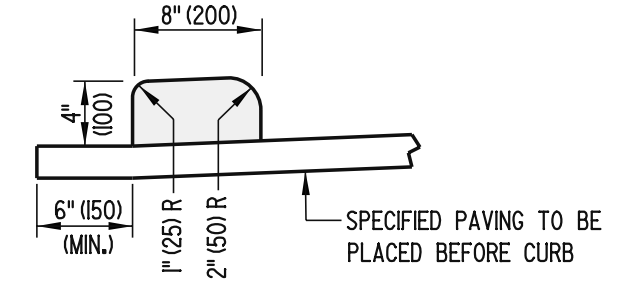

**HOT-MIX, HOT LAID BITUMINOUS CONCRETE CURB**

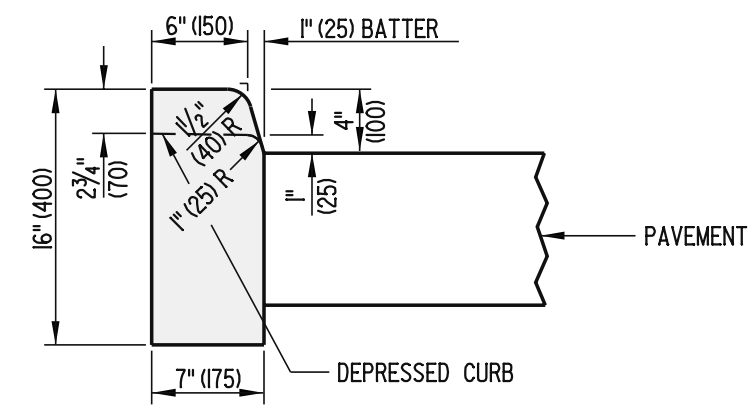

**P.C.C. CURB**  
TYPE 3

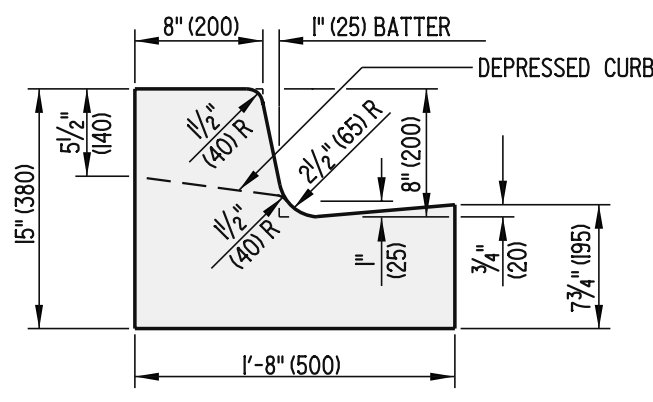

**INTEGRAL P.C.C. CURB AND GUTTER**  
TYPE 3

- NOTES:
1. WHEN P.C.C. CURB OR INTEGRAL P.C.C. CURB AND GUTTER IS PLACED ADJACENT TO PORTLAND CEMENT CONCRETE PAVEMENT, CONSTRUCT THE JOINT AS PER THE LONGITUDINAL JOINT SEALANT DETAIL ON STANDARD P-2, SHEET 3 OF 5. USE APPROVED JOINT FILLER TO SEAL. WORK TO BE PAID UNDER RESPECTIVE CURB AND GUTTER ITEM.
  2. DEPRESS CURB AT ENTRANCES AS DETAILED ON THIS SHEET.
  3. DEPRESS CURB FLUSH WITH PAVEMENT AT CURB RAMPS. MAXIMUM SLOPE OF CURB AT CURB RAMPS IS 20:1 IN THE DIRECTION OF PEDESTRIAN TRAVEL. SEE STANDARD NO C-2, 1 OF 4.