
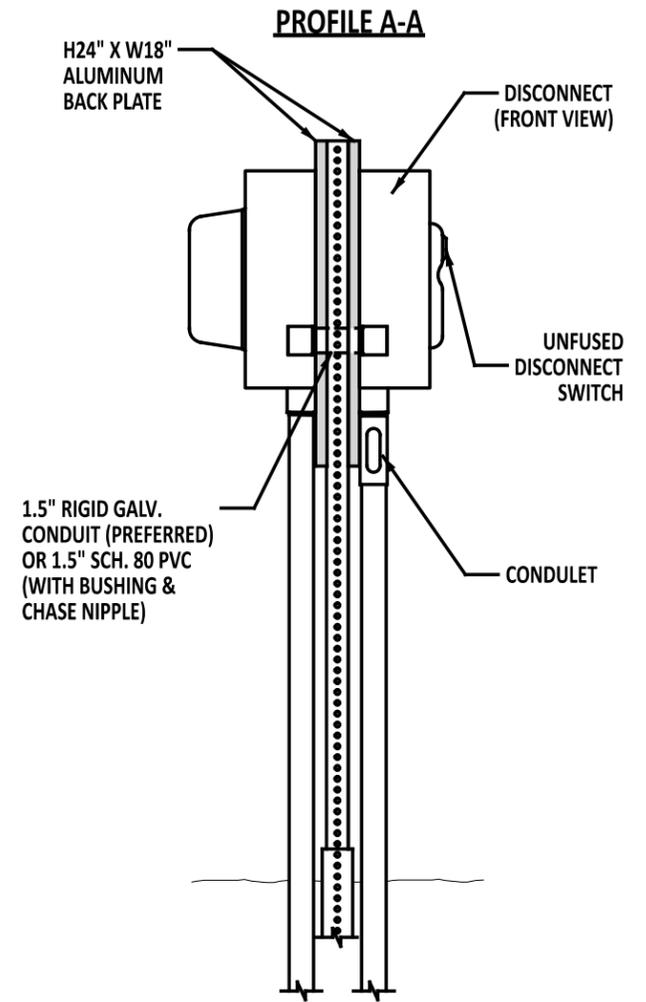


CONDENSED INSTALLATION (3+ DEVICES)

CONDENSED INSTALLATION (UP TO 2 DEVICES)

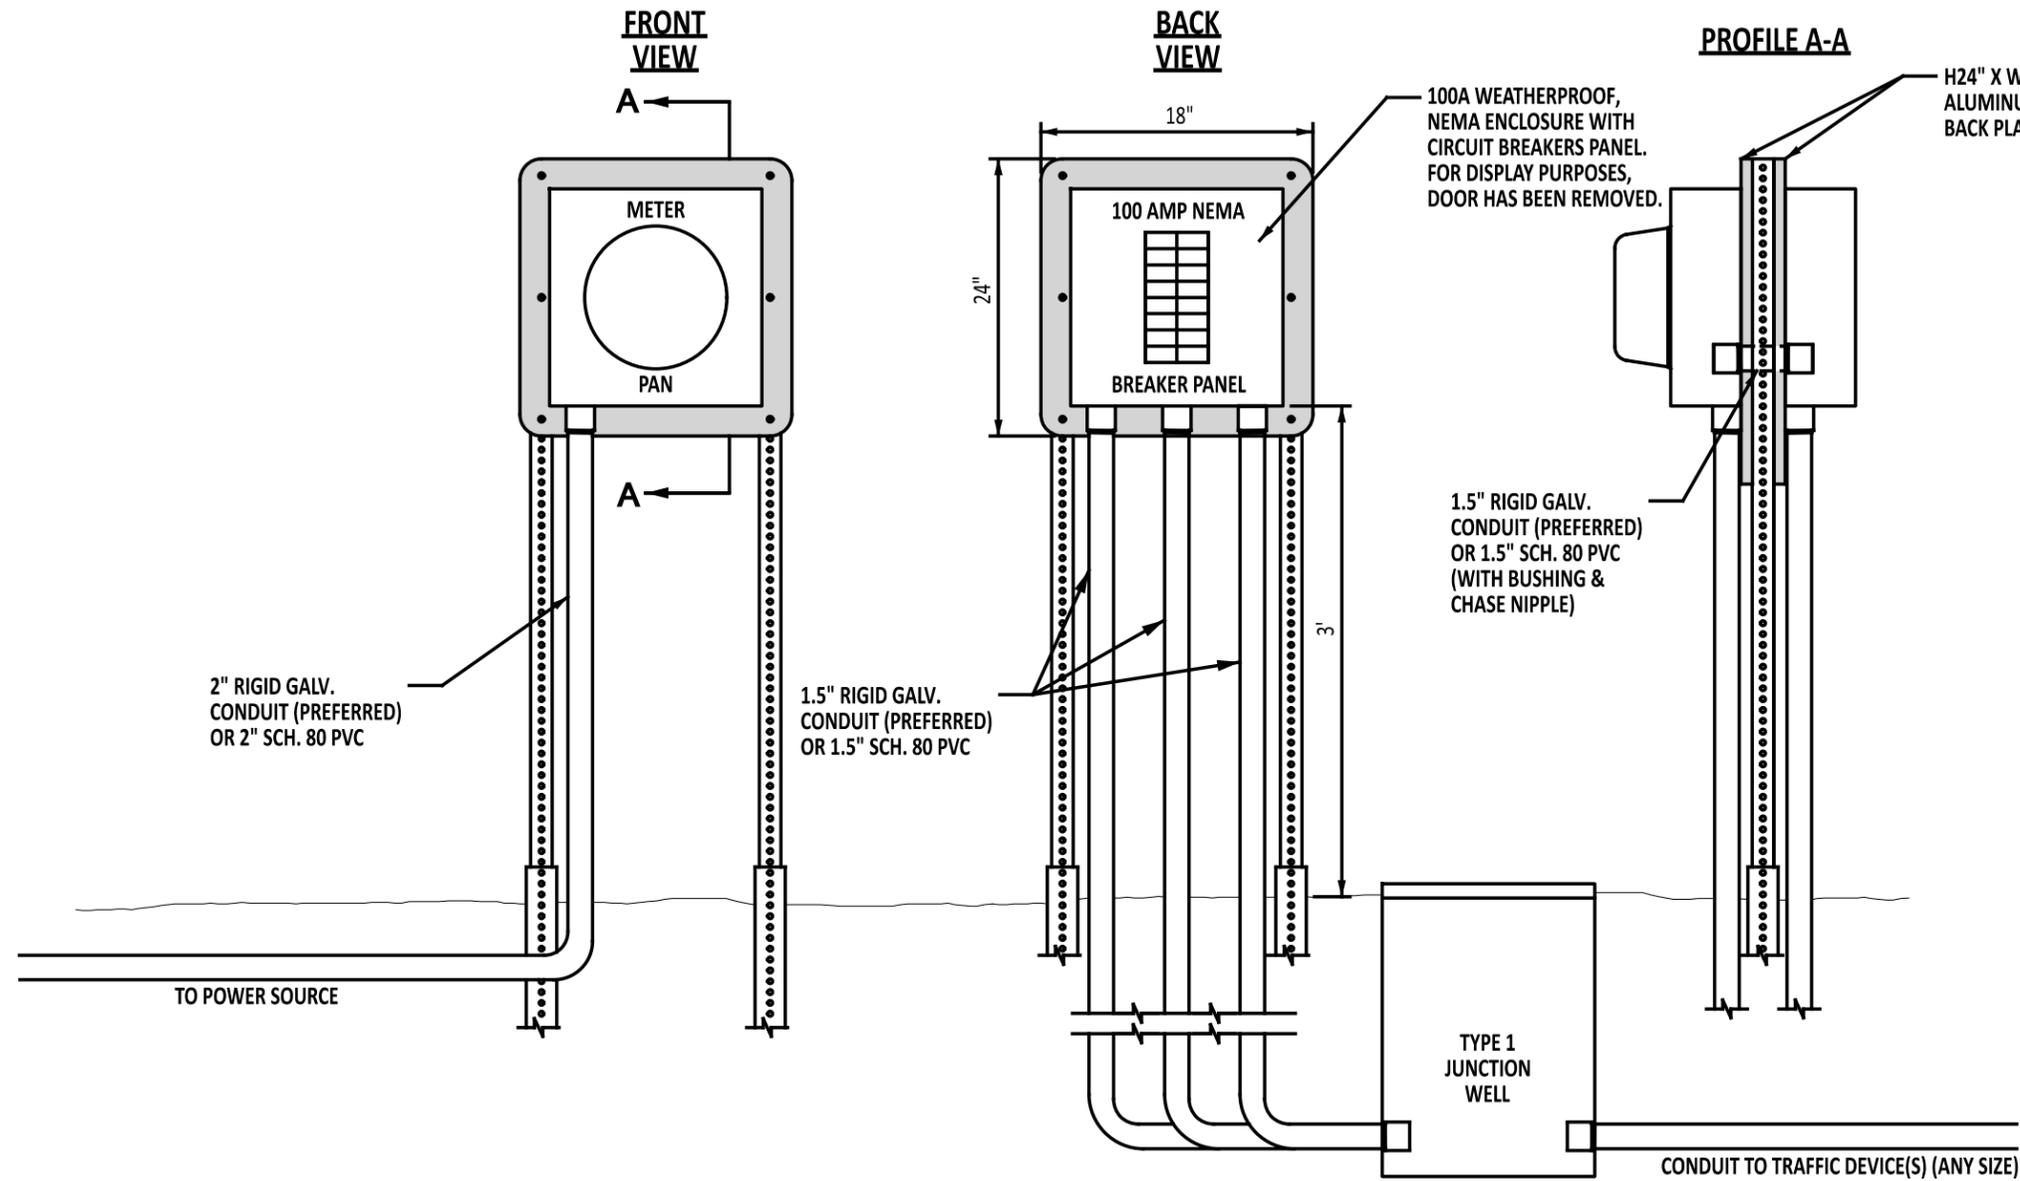

SPECIALTY DISCONNECT TYPICAL

NOTES

- 1.) PEDESTAL SHALL BE USED WHEN ALL DEVICES ARE CLOSE TO POWER SOURCE.
- 2.) PEDESTAL SHALL BE 5 FEET FROM JUNCTION WELL.
- 3.) TO BE USED FOR 3 OR MORE DEVICES WITHIN CONDENSED SPACE.

NOTES

- 1.) TO BE USED FOR 2 OR LESS DEVICES WITHIN CONDENSED SPACE.



ENGINEERING SUPPORT *Paul Johnson* 09/01/2020
RECOMMENDED

ELECTRICAL SERVICE PEDESTAL -
SIGNAL & ITS COMPONENT INSTALLATIONS - 100 AMP (CONDENSED)
STANDARD NO. T-17 (2020) SHT. 2 OF 5

REVIEWED

Mike Jones
DEPUTY DIRECTOR - DESIGN

09/01/2020
DATE

APPROVED

Shrey
CHIEF ENGINEER

09/01/2020
DATE